


## Electronic Pressure Sensors

Analogue output



## Display and visual indication

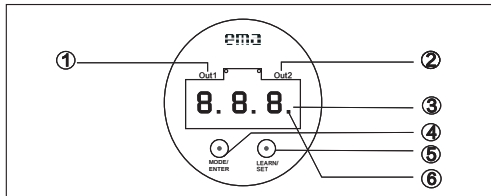

|   |                    |   |
|---|--------------------|---|
| ① | Out1               | Out1 status; lights on under connecting to the output terminal        |
| ② | Out2               | Out2 status; lights on under connecting to the output terminal        |
| ③ | 7-segment Display  | System pressure display, Parameter and parameter value display        |
| ④ | MODE/ENTER         | Selection of parameter and acknowledgement of parameter value         |
| ⑤ | LEARN/SET          | Setting of learn mode and parameter value                             |
| ⑥ | Millesimal display | The value displayed should be multiplied by 10 when this dot flashes. |

## Functions and features

By the probe, the pressure sensor can detect and then display the current system pressure; meanwhile, it can output two signals according to the setting of output.

| Output 1                      | Output 2               |
|-------------------------------|------------------------|
| Hysteresis function/N.O.(Hno) | Analogue<br>4~20 mA(I) |
| Hysteresis function/N.C.(Hnc) |                        |
| window function/N.O.(Fno)     | Analogue<br>0~10 V(U)  |
| window function/N.C.(Fnc)     |                        |



### Hysteresis

The hysteresis keeps the switching state of the outputs stable if the system pressure varies about the preset value.

When the system pressure is increasing, the output switches when the switch-on point has been reached (SP1); when the system pressure is decreasing again, the output switch-off point (rP1) has been reached. The hysteresis can be adjusted: first the switch-on point is set, then the switch-on point with the requested difference.

### Window function:

The window function enables the monitoring of a defined acceptable range. When the system pressure varies between the switch-on point (SP1) and the switch-off point (rP1), the output is switched (window function/NO) or not switched (window function/NC). The width of the window can be set by means of the difference between SP1 and rP1. SP1=upper value, rP1=lower value.



## Operating modes

### Run mode:

(Normal operating mode)

When the supply voltage has been applied, the unit is in the Run mode .it monitors and switches the transistor output according to the set parameters.

The value of the analogue output depends on the system pressure.

The digit display indicates the current system pressure; the red LED indicates the switching state of the transistor output.

### Display mode:

(Indication of parameters and the set parameter values)

When the “MODE/ENTER” button is pressed briefly, the unit passes to the Display mode which allows parameter values to be read. The internal sensing , processing and output functions of the unit continue as if in Run mode.

- The parameter names are scrolled with each pressing of the “MODE/ENTER” button.
- when the “LEARN/SET” button is pressed briefly, the corresponding parameter value is displayed for 5 sec. After another 5 sec. The unit returns to the Run mode.

### Programming mode:

(Setting of the parameter values)

The unit passes to the programming mode when after the selection of a parameter value ( Display mode ) the “LEARN / SET” button is pressed until the display of the parameter value is changed. Internally the unit remains in the operating mode. It continues its monitoring function with the existing parameters until the change has been terminated.


You can change the parameter value by pressing the “LEARN /SET” button and confirm it by pressing the “MODE/ENTER” button. The unit returns to the Run mode when no button has been pressed for 5 second.


## Menu setting


| Menu                             | Function   | Range                    |                                    |
|----------------------------------|--|--------------------------|------------------------------------|
| OU1                              | Output1  | SP1 Switch point1        | See table 1                        |
|                                  |  | rP1 Switch point         |                                    |
|                                  |  | FUN function             | Hno Hysteresis NO                  |
|                                  |  |                          | Hnc Hysteresis NC                  |
|                                  |  |                          | Fno Window NO                      |
|                                  |  |                          | Fnc Window NC                      |
|                                  |  | N-P Output selection     | NPN                                |
|                                  |  |                          | PNP                                |
|                                  |  | dS1 Delay for switch on  | Range: 0~50s<br>Step of range:0.1s |
|                                  |  | dr1 Delay for switch off | Range: 0~50s<br>Step of range:0.1s |
| dA1 Damping for switching output | Filter out high frequency pressure spikes or instantaneous<br>Setting range 0 ~ 2s<br>Step past 0.008s |                          |                                    |

|     |          |                               |   |  |       |
|-----|----------|-------------------------------|---|--|-------|
| OU2 | Output 2 | U_I                           | Analogue output selection   | U(0-10V)<br>I(4-20MA)                        |       |
|     |          | ASP                           | Analogue start point  | See table 1 for corresponding pressure range |       |
|     |          | AEP                           | Analogue end point  | See table 1 for corresponding pressure range |       |
|     |          | DA2                           | Damping for Analogue output   | 0-2s   | 0.08s |
| UNI |          | Unit selection                |   | bar  |       |
|     |          |                               |   | psi  |       |
|     |          |                               |   | kgf/cm <sup>2</sup>                          |       |
|     |          |                               |   | MPa  |       |
| DIS | DEL      | Update rate and display       | 0ms/50ms/200ms/600ms/OFF  |  |       |
|     | P_D      | Positive and Opposite display | P positive display, D opposite display                                  |  |       |
| EF  | COF      | Calibration                   | -5%~+5% of Full Sensing Range   | 0.1  |       |
|     | CAR      | Zero-point Calibration        | Clean the COF setting value   |  |       |
|     | PH       | Max. value record             | Recording Max. value during operation and back to zero after power off. |  |       |

## Programming

- 

Press the “MODE/ENTER” button several times until the respective parameter is displayed.
- 

Press the “SET” button and keep it pressed. The current parameter value is indicated in 5 sec., then the value is increased (incremental by pressing briefly or scrolling by holding pressed).
- 

Press the “MODE/ENTER” button briefly (=acknowledgement). The parameter is displayed again; the set parameter value becomes effective.

Decrease parameter value: Make the parameter value displayed reach the highest of the parameter setting, and then recycle to the highest value from the lowest.

### Lock/Unlock:

**Lock:**This unit features auto-lock function. When there is no button being pressed in 1 minute, it will be locked automatically. The monitor of the pressure is running normally.


**Unlock:** Keep pressing “LEARN/SET” button under the normal pressure display mode (run mode), and then press “MODE/ENTER” for 10 sec. until the “ULC” is displayed, meaning that it's unlock. The original setting is under lock mode.

## Error status

Detecting safety of device if the operation works ineffective.  
Error status:

|    |   |
|----|---|
| OL | Pressure value is too high  |
| LO | Pressure value is too low   |
| Sc | Short-circuit or excessive current in the switching output; the PNP-NPN output is switched on. (Flashing) |

## Connection

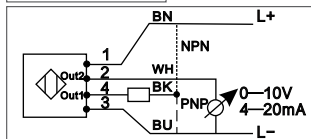

Core color:

- 1 = BN (brown);
- 2 = WH (white);
- 3 = BU (blue);
- 4 = BK (black)

## Electrical connection




The unit must only be connected by an electrician.  
The national and international regulations for the installation of electrical equipment must be observed.  
Voltage supply to EN50178, SELV, PELV.  
Disconnect power before connecting the unit.

## Technical data

Detected objects: Relative medium for gas and liquid

|                                   |   |
|-----------------------------------|---|
| Electric design                   | DC                                      |
| Operating voltage[V]              | 18...36DC                               |
| Measuring range[ bar ]            | -1...1/2/5/10/20/50/100/200/250/400/600 |
| Max.overload pressure[ bar ]      | 5/8/20/35/60/140/300/400/500/650/880    |
| Measuring range[ mbar ]           | -100...100/-100...250/-100...500        |
| Max.overload pressure[ mbar ]     | 1.3/1.3/1.3                             |
| Load current[mA]                  | 300                                     |
| Short-circuit protection          | pulse                                   |
| Reverse polarity protection       | Yes                                     |
| Overload protection               | Yes                                     |
| Watchdog                          | Yes                                     |
| Voltage drop[V]                   | <2                                      |
| Current consumption[mA]           | <60                                     |
| Switching output                  | PNP/NPN programmable                    |
| The accuracy of switch point[%]   | < ± 0.5                                 |
| Analogue output                   | 4...20mA/0...10V programmable           |
| Analogue output 4-20mA load[Ohm]  | Max500                                  |
| Analogue output 0-10V load[Ohm]   | Min1000                                 |
| Analogue output Reaction time[ms] | <3                                      |
| Operating temperature[°C/°F]      | -25...+80/-13...+176                    |
| Medium temperature[°C/°F]         | -25...+80/-13...+176                    |
| Storage temperature[°C/°F]        | -40...100/-40...+212                    |
| Insulation resistance[MΩ]         | >100(500 V DC)                          |
| Shock resistance[g]               | 50                                      |
| Vibration resistance[g]           | 20                                      |
| Switching cycles Min              | one billion                             |
| Housing material                  | stainless steel304                      |
| Probe material                    | high-class stainless steel316L          |
| Protection classification         | IP68                                    |

## Dimensions

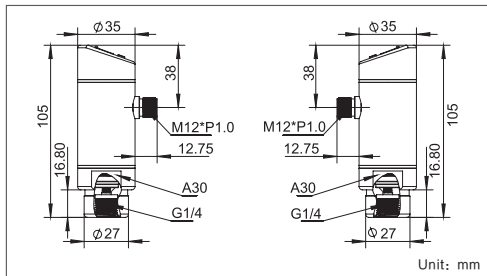

## Mounting and maintenance

1. To reduce the shock to the product, please install this product vertically to the flow of medium.
2. To avoid damage of the product, please do not make the loading pressure of the product exceed the range of acceptable pressure by twice.
3. When pressure sensing range is higher than 100 bar (including 100 bar), the device must be mounted with damping screw, so that it can prevent impact caused during valve opening moment.

Table1

| Range [mbar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|--------------|---------------------|---------------------|---------------------|------------|
| -100...100   | mbar                | -99...100           | -100...99           | 1          |
|              | Psi                 | -1.44...1.45        | -1.45...1.44        | 0.02       |
|              | kgf/cm <sup>2</sup> | -0.099...0.100      | -0.100...0.99       | 0.001      |
| -100...250   | bar                 | -0.099...0.100      | -0.100...0.99       | 0.001      |
|              | mbar                | -99...250           | -100...249          | 1          |
|              | Psi                 | -1.43...3.60        | -1.45...3.58        | 0.02       |
| -100...500   | kgf/cm <sup>2</sup> | -0.099...0.250      | -0.100...0.249      | 0.001      |
|              | bar                 | -0.099...0.250      | -0.100...0.249      | 0.001      |
|              | mbar                | -99...500           | -100...499          | 1          |
| -100...500   | Psi                 | -1.43...7.25        | -1.45...7.23        | 0.02       |
|              | kgf/cm <sup>2</sup> | -0.099...0.500      | -0.100...0.449      | 0.001      |
|              | bar                 | -0.099...0.500      | -0.100...0.449      | 0.001      |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| -1...1      | bar                 | -0.98...1.00        | -0.99...0.99        | 0.01       |
|             | Psi                 | -14.2...14.6        | -14.4...14.4        | 0.20       |
|             | kgf/cm <sup>2</sup> | -0.98...1.02        | 0.99...1.01         | 0.01       |
|             | Mpa                 | -0.098...0.10       | -0.099...0.099      | 0.001      |
| 2           | bar                 | 0.02...2.00         | 0.01...1.99         | 0.01       |
|             | Psi                 | 0.40...29.0         | 0.20...28.8         | 0.20       |
|             | kgf/cm <sup>2</sup> | 0.02...2.04         | 0.01...2.03         | 0.01       |
|             | Mpa                 | 0.002...0.20        | 0.001...0.199       | 0.001      |
| 5           | bar                 | 0.04...5.00         | 0.02...4.98         | 0.02       |
|             | Psi                 | 0.80...72.4         | 0.40...72.0         | 0.40       |
|             | kgf/cm <sup>2</sup> | 0.04...5.10         | 0.02...5.08         | 0.02       |
|             | Mpa                 | 0.004...0.50        | 0.002...0.498       | 0.002      |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 10          | bar                 | 0.10...10.0         | 0.05...9.95         | 0.05       |
|             | Psi                 | 2.00...145          | 1.00...144          | 1.00       |
|             | kgf/cm <sup>2</sup> | 0.10...10.2         | 0.05...10.1         | 0.05       |
|             | Mpa                 | 0.01...1.00         | 0.005...0.995       | 0.005      |
| 20          | bar                 | 0.20...20.0         | 0.10...19.9         | 0.10       |
|             | Psi                 | 4.00...290          | 2.00...288          | 2.00       |
|             | kgf/cm <sup>2</sup> | 0.20...20.4         | 0.10...20.3         | 0.10       |
|             | Mpa                 | 0.02...2.00         | 0.01...1.99         | 0.01       |
| 50          | bar                 | 0.40...50.0         | 0.20...49.8         | 0.20       |
|             | Psi                 | 8.00...724          | 4.00...720          | 4.00       |
|             | kgf/cm <sup>2</sup> | 0.40...51.0         | 0.20...50.8         | 0.20       |
|             | Mpa                 | 0.04...5.00         | 0.02...4.98         | 0.02       |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 100         | bar                 | 1.00...100          | 0.50...99.5         | 0.50       |
|             | Psi                 | 20.0...1450         | 10.0...1440         | 10.0       |
|             | kgf/cm <sup>2</sup> | 0.10...10.2         | 0.50...101          | 0.50       |
|             | Mpa                 | 0.10...10.0         | 0.05...9.95         | 0.05       |
| 200         | bar                 | 2.00...200          | 1.00...199          | 1.00       |
|             | Psi                 | 30.0...2895         | 15.0...2880         | 15.0       |
|             | kgf/cm <sup>2</sup> | 2.00...204          | 1.00...203          | 1.00       |
|             | Mpa                 | 0.20...20.0         | 0.10...19.9         | 0.10       |
| 250         | bar                 | 2.00...250          | 1.00...249          | 1.00       |
|             | Psi                 | 30.0...3495         | 15.0...3480         | 15.0       |
|             | kgf/cm <sup>2</sup> | 2.00...255          | 1.00...254          | 1.00       |
|             | Mpa                 | 0.20...25.0         | 0.10...24.9         | 0.10       |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 400         | bar                 | 4.00...400          | 2.00...398          | 2.00       |
|             | Psi                 | 60.0...5790         | 30.0...5760         | 30.0       |
|             | kgf/cm <sup>2</sup> | 4.00...408          | 2.00...406          | 2.00       |
|             | Mpa                 | 0.40...40.0         | 0.20...39.8         | 0.20       |
| 600         | bar                 | 4.00...600          | 2.00...598          | 2.00       |
|             | Psi                 | 60.0...8700         | 30.0...8680         | 30.0       |
|             | kgf/cm <sup>2</sup> | 4.00...612          | 2.00...610          | 2.00       |
|             | Mpa                 | 0.40...60.0         | 0.20...59.8         | 0.20       |




# Electronic Pressure sensors

Switching output



[www.ema-electronic.com](http://www.ema-electronic.com)

## Display and visual indication

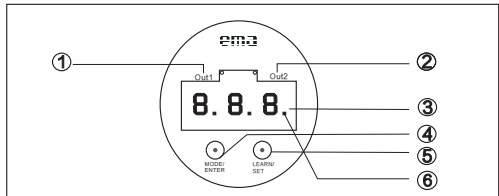

|   |                    |   |
|---|--------------------|---|
| ① | Out1               | Out1 status; lights on under connecting to the output terminal        |
| ② | Out2               | Out2 status; lights on under connecting to the output terminal        |
| ③ | 7-segment Display  | System pressure display, Parameter and parameter value display        |
| ④ | MODE/ENTER         | Select on of parameter and acknowledgement of parameter value         |
| ⑤ | LEARN/SET          | Setting of learn mode and parameter value                             |
| ⑥ | Millesimal display | The value displayed should be multiplied by 10 when this dot flashes. |

## Functions and features

By the probe, the pressure sensor can detect and then display the current system pressure; meanwhile, it can output two signals according to the setting of output.

| Output 1                      | Output 2               |
|-------------------------------|------------------------|
| Hysteresis function/N.O.(Hno) | Analogue<br>4~20 mA(I) |
| Hysteresis function/N.C.(Hnc) |                        |
| window function/N.O.(Fno)     | Analogue<br>0~10 V(U)  |
| window function/N.C.(Fnc)     |                        |



## Hysteresis

The hysteresis keeps the switching state of the outputs stable if the system pressure varies about the preset value.

When the system pressure is increasing, the output switches when the switch-on point has been reached (SP1); when the system pressure is decreasing again, the output switch-off point (rP1) has been reached. The hysteresis can be adjusted: first the switch-on point is set, then the switch-on point with the requested difference.

## Window function:

The window function enables the monitoring of a defined acceptable range. When the system pressure varies between the switch-on point (SP1) and the switch-off point (rP1), the output is switched (window function/NO) or not switched (window function/NC). The width of the window can be set by means of the difference between SP1 and rP1. SP1=upper value, rP1=lower value.



## Diagnostic function

If OUT2=dEs,OUT2 will be use for diagnostic output.(1)If there is no error ,OUT2output UB+(OUT1=PNP),(2)If there is an error ,OUT2 output invalid, maybe has the following problems;measurement of small defects;OUT1 overload or short circuit;exceed or not meet the limitation of measurement range;EEPRON error;RAM error;CPU error.

## Operating modes

### Run mode:

(Normal operating mode)

When the supply voltage has been applied, the unit is in the Run mode .it monitors and switches the transistor output according to the set parameters. The value of the analogue output depends on the system pressure. The digit display indicates the current system pressure; the red LED indicates the switching state of the transistor output.

### Display mode:

(Indication of parameters and the set parameter values)

When the "MODE/ENTER" button is pressed briefly, the unit passes to the Display mode which allows parameter values to be read. The internal sensing , processing and output functions of the unit continue as if in Run mode.

- The parameter names are scrolled with each pressing of the "MODE/ENTER" button.
- when the "LEARN/SET" button is pressed briefly, the corresponding parameter value is displayed for 5 sec.After another 5 sec.The unit returns to the Run mode.

### Programming mode:

(Setting of the parameter values)

The unit passes to the programming mode when after the selection of a parameter value ( Display mode) the "LEARN/ SET" button is pressed until the display of the parameter value is changed. Internally the unit remains in the operating mode .It continues its monitoring function with the existing parameters until the change has been terminated.You can change the parameter value by pressing the "LEARN/SET" button and confirm it by pressing the "MODE/ENTER" button. The unit returns to the Run mode when no button has been pressed for 5 second.


## Menu setting


| Menu                             | Function   | Range                    |                                    |
|----------------------------------|--|--------------------------|------------------------------------|
| OU1                              | Output1  | SP1 Switch point1s       | See table 1                        |
|                                  |  | rP1 Switch point1s       |                                    |
|                                  |  | FUN function             | Hno Hysteresis NO                  |
|                                  |  |                          | Hnc Hysteresis NC                  |
|                                  |  |                          | Fno Window NO                      |
|                                  |  |                          | Fnc Window NC                      |
|                                  |  | N-P Output selection     | NPN output                         |
|                                  |  |                          | PNP output                         |
|                                  |  | dS1 Delay for switch on  | Range: 0~50s<br>Step of range:0.1s |
|                                  |  | dr1 Delay for switch off | Range: 0~50s<br>Step of range:0.1s |
| dA1 Damping for switching output | Filter out high frequency pressure spikes or instantaneous<br>Setting range 0 ~ 2s<br>Step past 0.008s |                          |                                    |


| Menu                             | Function   | Range                    |                                    |
|----------------------------------|--|--------------------------|------------------------------------|
| OU2                              | Output2  | SP2 Switch point2        | See table 1                        |
|                                  |  | rP2 Switch point2        |                                    |
|                                  |  | FUN function             | Hno Hysteresis NO                  |
|                                  |  |                          | Hnc Hysteresis NC                  |
|                                  |  |                          | Fno Window NO                      |
|                                  |  |                          | Fnc Window NC                      |
|                                  |  | N-P Output selection     | dES diagnostic output(NC)          |
|                                  |  |                          | NPN output<br>PNP output           |
|                                  |  | dS2 Delay for switch on  | Range: 0~50s<br>Step of range:0.1s |
|                                  |  | dr2 Delay for switch off | Range: 0~50s<br>Step of range:0.1s |
| dR2 Damping for switching output | Filter out high frequency pressure spikes or instantaneous<br>Setting range 0 ~ 2s<br>Step past 0.008s |                          |                                    |

|     |                   |                        |                               |  |
|-----|-------------------|------------------------|-------------------------------|--|
| UN1 | unit conversion   | bar                    |                               |  |
|     |                   | Psi                    |                               |  |
|     |                   | kgf/cm2                |                               |  |
|     |                   | Mpa                    |                               |  |
| DIS | P_D               | DEL                    | Update rate and display       | 0ms/50ms/200ms/600ms/OFF   |
|     |                   | P_D                    | Positive and Opposite display | P positive display, D opposite display   |
| EF  | Enhanced Function | COF Calibration offset |                               | Theory value(sensor's operating value ) and measured value exist deviation<br>Setting range: -5%...+5% of pressure measured range<br>Step range: 0.1% of pressure measured range |
|     |                   | CRr                    | Zero point calibration        |  |
|     |                   | PH                     | Max. value record             | Recording Max. value during operation and back to zero after power off.  |

## Programming

- 

Press the “MODE/ENTER” button several times until the respective parameter is displayed.
- 

Press the “SET” button and keep it pressed. The current parameter value is indicated in 5 sec., then the value is increased (incremental by pressing briefly or scrolling by holding pressed).
- 

Press the “MODE/ENTER” button briefly (=acknowledgement). The parameter is displayed again; the set parameter value becomes effective.

Decrease parameter value: Make the parameter value displayed reach the highest of the parameter setting, and then recycle to the highest value from the lowest.

## Lock/Unlock:

**Lock:** This unit features auto-lock function. When there is no button being pressed in 1 minute, it will be locked automatically. The monitor of the pressure is running and outputting normally.

**Unlock:** Keep pressing "LEARN/SET" button under the normal pressure display mode (run mode), and then press "MODE /ENTER" for 10 sec. until the "ULC" is displayed, meaning that it's unlock. The original setting is under lock mode.

## Error status


Detecting safety of device if the operation works ineffective.

Error status:

|     |   |
|-----|---|
| OL  | Pressure value is too high                  |
| LO  | Pressure value is too low                   |
| SC1 | OUT1 output overload or short circuit       |
| SC2 | OUT2 output overload or short circuit       |
| SC  | OUT1 and OUT2 are overload or short circuit |
| Err | Internal error                              |

If the above situations continued, output will be closed


## Connection

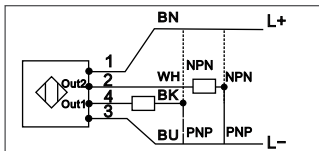

Core color:

- 1 = BN (brown);
- 2 = WH (white);
- 3 = BU (blue);
- 4 = BK (black);

## Dimensions

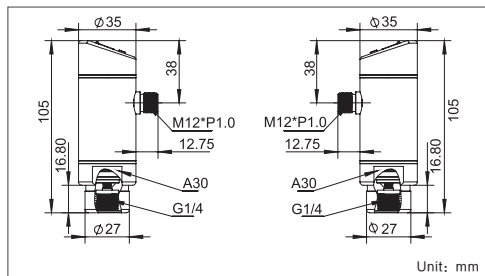

## Mounting and maintenance

1. To reduce the shock to the product, please install this product vertically to the flow of medium.
2. To avoid damage of the product, please do not make the loading pressure of the product exceed the range of acceptable pressure by twice.
3. When pressure sensing range is higher than 100 bar (including 100 bar), the device must be mounted with damping screw, so that it can prevent impact caused during valve opening moment.

## Electrical connection



The unit must only be connected by an electrician. The national and international regulations for the installation of electrical equipment must be observed.

Voltage supply to EN50178,SELV,PELV.  
Disconnect power before connecting the unit.

## Technical data

**Detected objects: Relative medium for gas and liquid**

|                              |   |
|------------------------------|---|
| Electric design              | DC                                      |
| Operating voltage[V]         | 18...36V                                |
| Measuring range[ bar ]       | -1...1/2/5/10/20/50/100/200/250/400/600 |
| Max.overload pressure[ bar ] | 5/8/20/35/60/140/300/400/500/650/880    |
| Load current[mA]             | 300                                     |
| Short-circuit protection     | pulse                                   |
| Reverse polarity protection  | Yes                                     |
| Overload protection          | Yes                                     |
| Watchdog                     | Yes                                     |
| Voltage drop[V]              | <2                                      |
| Current consumption[mA]      | <60                                     |
| Operating temperature[°C/°F] | -25...+80/-13...+176                    |
| Medium temperature[°C/°F]    | -25...+80/-13...+176                    |
| Storage temperature[°C/°F]   | -40...100/-40...+212                    |
| Insulation resistance[MΩ]    | >100(500 V DC)                          |
| Shock resistance[g]          | 50                                      |
| Vibration resistance[g]      | 20                                      |
| switching cycles Min         | one billion                             |
| Housing material             | stainless steel 304                     |
| Probe material               | high-class stainless steel 316L         |
| Protection classification    | IP68                                    |

Table1

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| -1...1      | bar                 | -0.98...1.00        | -0.99...0.99        | 0.01       |
|             | Psi                 | -14.2...14.6        | -14.4...14.4        | 0.20       |
|             | kgf/cm <sup>2</sup> | -0.98...1.02        | -0.99...1.01        | 0.01       |
|             | Mpa                 | -0.098...0.10       | -0.099...0.099      | 0.001      |
| 2           | bar                 | 0.02...2.00         | 0.01...1.99         | 0.01       |
|             | Psi                 | 0.40...29.0         | 0.20...28.8         | 0.20       |
|             | kgf/cm <sup>2</sup> | 0.02...2.04         | 0.01...2.03         | 0.01       |
|             | Mpa                 | 0.002...0.20        | 0.001...0.199       | 0.001      |
| 5           | bar                 | 0.04...5.00         | 0.02...4.98         | 0.02       |
|             | Psi                 | 0.80...72.4         | 0.40...72.0         | 0.40       |
|             | kgf/cm <sup>2</sup> | 0.04...5.10         | 0.02...5.08         | 0.02       |
|             | Mpa                 | 0.004...0.5         | 0.002...0.498       | 0.002      |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 10          | bar                 | 0.10...10.0         | 0.05...9.95         | 0.05       |
|             | Psi                 | 2.00...145          | 1.00...144          | 1.00       |
|             | kgf/cm <sup>2</sup> | 0.10...10.2         | 0.05...10.1         | 0.05       |
|             | Mpa                 | 0.01...1.00         | 0.005...0.995       | 0.005      |
| 20          | bar                 | 0.20...20.0         | 0.10...19.9         | 0.10       |
|             | Psi                 | 4.00...290          | 2.00...288          | 2.00       |
|             | kgf/cm <sup>2</sup> | 0.20...20.4         | 0.10...20.3         | 0.10       |
|             | Mpa                 | 0.02...2.00         | 0.01...1.99         | 0.01       |
| 50          | bar                 | 0.40...50.0         | 0.20...49.8         | 0.20       |
|             | Psi                 | 8.00...724          | 4.00...720          | 4.00       |
|             | kgf/cm <sup>2</sup> | 0.40...51.0         | 0.20...50.8         | 0.20       |
|             | Mpa                 | 0.04...5.00         | 0.02...4.98         | 0.02       |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 100         | bar                 | 1.00...100          | 0.50...99.5         | 0.50       |
|             | Psi                 | 20.0...1450         | 10.0...1440         | 10.0       |
|             | kgf/cm <sup>2</sup> | 0.10...10.2         | 0.50...101          | 0.50       |
|             | Mpa                 | 0.10...10.0         | 0.05...9.95         | 0.05       |
| 200         | bar                 | 2.00...200          | 1.00...199          | 1.00       |
|             | Psi                 | 30.0...2895         | 15.0...2880         | 15.0       |
|             | kgf/cm <sup>2</sup> | 2.00...204          | 1.00...203          | 1.00       |
|             | Mpa                 | 0.20...20.0         | 0.10...19.9         | 0.10       |
| 250         | bar                 | 2.00...250          | 1.00...249          | 1.00       |
|             | Psi                 | 30.0...3495         | 15.0...3480         | 15.0       |
|             | kgf/cm <sup>2</sup> | 2.00...255          | 1.00...254          | 1.00       |
|             | Mpa                 | 0.20...25.0         | 0.10...24.9         | 0.10       |

| Range [bar] | Unit                | SP1/2 Setting Range | rP1/2 Setting Range | Step Range |
|-------------|---------------------|---------------------|---------------------|------------|
| 400         | bar                 | 4.00...400          | 2.00...398          | 2.00       |
|             | Psi                 | 60.0...5790         | 30.0...5760         | 30.0       |
|             | kgf/cm <sup>2</sup> | 4.00...408          | 2.00...406          | 2.00       |
|             | Mpa                 | 0.40...40.0         | 0.20...39.8         | 0.20       |
| 600         | bar                 | 4.00...600          | 2.00...598          | 2.00       |
|             | Psi                 | 60.0...8700         | 30.0...8680         | 30.0       |
|             | kgf/cm <sup>2</sup> | 4.00...612          | 2.00...610          | 2.00       |
|             | Mpa                 | 0.40...60.0         | 0.20...59.8         | 0.20       |

**ema**<sup>®</sup>

M-PD-EN-V1.1


## Pressure and Temperature Sensors



[www.ema-electronic.com](http://www.ema-electronic.com)



## Display and Visual indication

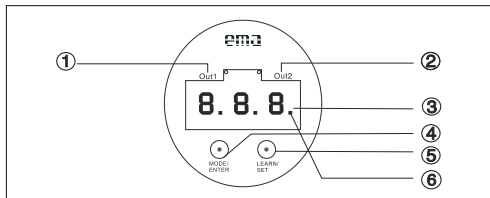

|   |                    |   |
|---|--------------------|---|
| ① | Out1               | Out1 status: lights on when connecting to the output terminal                 |
| ② | Out2               | Out 2 status: lights on when connecting to the output terminal                |
| ③ | 7-segment Display  | System pressure or temperature display, Parameter and parameter value display |
| ④ | MODE/ENTER         | Selection of parameters and acknowledgement of parameters value               |
| ⑤ | LEARN/SET          | Setting of learn mode and parameter value                                     |
| ⑥ | Millesimal Display | The value displayed should be multiplied by 10 when this dot flashes.         |

## Functions and features

Through the probe, the pressure sensor can detect and then display the current system pressure; Meanwhile, it can output two signals according to output setting.

| Output 1                       | Output 2               | Measuring range |            |
|--------------------------------|------------------------|-----------------|------------|
| Hysteresis function/N.O. (Hno) | Analogue<br>4~20 mA(I) | °C              | -40...+150 |
| Hysteresis function/N.C. (Hnc) |                        |                 |            |
| Window function/N.O. (Fno)     | Analogue<br>0~10 V(U)  | °F              | -40...+302 |
| Window function/N.C. (Fnc)     |                        |                 |            |



### Hysteresis

The hysteresis keeps the switching state of the outputs stable if the system temperature varies about the preset value. When the system temperature is increasing, the output switches when the switch-on point has been reached (SP1); when the system temperature is decreasing again, the output switch-off point (rP1) has been reached. The hysteresis can be adjusted: first the switch-on point is set, then the switch-on point with the requested difference.

### Windows function

The window function enables the monitoring of a defined acceptable range. When the system temperature varies between the switch-on point (SP1) and the switch-off point (rP1), the output is switched (window function/NO) or not switched (window function/NC).

The width of the window can be set by means of the difference between SP1 and rP1. SP1=upper value, rP1=lower value.



## Operating mode

### Run mode:

(Normal operating mode)

When the supply voltage has been applied, the unit is in the Run mode. It monitors and switches the transistor output according to the set parameters.

The value of the analogue output depends on the system pressure.

The digit display indicates the current system pressure or temperature value; the red LED indicates the switching state of the transistor output.

### Display mode:

(Indication of parameters and the set parameter values)

When the display indicates the pressure value, press "MODE/ENTER" button, then it turn to the temperature value. When the display show the temperature value, press "MODE/ENTER", then it turn to the pressure value.

The unit passes to the Display mode which allows parameter values to be read. The internal data, processing and output remain as Run mode.

- The parameter names are scrolled with each pressing of the "MODE/ENTER" button.
- When the "LEARN/SET" button is pressed briefly, the corresponding parameter value is displayed for 5 second. After another 5 second, the unit returns to the Run mode.

### Programming mode:

(Setting of the parameter values)

After enter a set parameter value (Display mode), the unit passes to the Programming mode. Continue to press "LEARN / SET" button is pressed until the display of the parameter value is changed. Internally the unit remains in the Operating mode.

The unit keep monitoring the existing parameters until the parameter value change.


The user can change the parameter value by pressing the "LEARN / SET" button and confirm it by pressing the "MODE/ENTER" button. The unit returns to the Run mode when no button is pressed for 5 second.


## Menu Setting


| Menu                 | Function                                   | Range             |  |  |
|----------------------|--|-------------------|--|--|
| OU1                  | Output 1                                   | SP1               | Switch point 1: the upper limit value of the output  | Celsius:<br>-39.5°C...+150°C<br>Step of range: 0.5 |
|                      |  |                   | Fahrenheit:<br>-39°F...+302°F<br>Step of range: 1    |  |
|                      |  | rP1               | Reverse point 1: the lower limit value of the output | Celsius:<br>-40°C...+149.5°C<br>Step of range: 0.5 |
|                      |  |                   |  | Fahrenheit:<br>-40°F...+301°F<br>Step of range: 1  |
| FUN function         | Function configuration of switching output | Hno Hysteresis NO |  |  |
|                      |  | Hnc Hysteresis NC |  |  |
|                      |  | Fno Window NO     |  |  |
|                      |  | Fnc Window NC     |  |  |
| N-P Output selection | Switching output selection                 | NPN:NPN Output    |  |  |
|                      |  | PNP:PNP Output    |  |  |

|     |                               |     |                                     |   |
|-----|-------------------------------|-----|-------------------------------------|---|
| OU2 | Output 2                      | U_I | Analogue output selection           | U(0-10V):Voltage output<br>I(4-20mA): Current output  |
|     |                               | ASP | Analogue start point                | Different pressure value according to different range   |
|     |                               | AEP | Analogue end point                  | Different pressure value according to different range   |
|     |                               | DA2 | Damping for analogue output         | Filter out high frequency pressure spikes or instantaneous<br>Setting range: 0-2s<br>Step of range: 0.08s |
| PEF | Pressure advanced function    | UNI | Unit selection                      | bar<br>psi<br>kgf/cm <sup>2</sup><br>Mpa  |
|     |                               | COF | Calibration                         | Setting range: -5%...+5% of sensing range<br>Setting Step of range: 0.1%                                  |
|     |                               | CAR | Zero-point calibration              | Clean the COF setting value   |
|     |                               | PH  | Max. Value recode                   | Recording Max. value during operation and back to zero after power off.                                   |
| TEF | Temperature advanced function | C_F | unit selection                      | °C:Celsius<br>°F:Fahrenheit   |
|     |                               | CAL | Calibration                         | Celsius: -9.9°C--+9.9°C<br>Step of range:0.1<br>Fahrenheit:<br>-17.5°F--+17.5°F<br>Step of range:0.5      |
|     |                               | HI  | Max. temperature record             | Recording Max. temperature value during operation and back to zero after power off.                       |
|     |                               | LO  | Mini. temperature record            | Recording Mini. temperature value during operation and back to zero after power off.                      |
| DIS | display function improve      | DEL | display update rate                 | 0ms/50ms/200ms/600ms  |
|     |                               | P_d | Positive and opposite display       | p:positive display<br>d:opposite display  |
|     |                               | SPT | temperature/pressure display switch | S-P:pressure display<br>S-T:temperature display   |

## Programming

- 

Press the “MODE/ENTER” button several times until the respective parameter is displayed.
- 

Press the “SET” button and keep it pressed. The current parameter value is indicated in 5 sec., then the value is increased (incremental by pressing briefly or scrolling by holding pressed).
- 

Press the “MODE/ENTER” button briefly (=acknowledgement). The parameter is displayed again; the set parameter value becomes effective.

Decrease parameter value: Make the parameter value displayed reach the highest of the parameter setting, and then recycle to the highest value from the lowest.

## Lock/Unlock :

**Lock:** This unit features auto-lock function. When there is no button being pressed in 1 minute, it will be locked automatically. The monitor of the pressure is running normally.


**Unlock:** Keep pressing “LEARN/SET” button under the normal pressure display mode (run mode), and then press “MODE/ENTER” for 10 sec. until the “ULC” is displayed, meaning that it's unlock. The original setting is under lock mode.

## Device setting/operation

Detecting safety of device if the operation works ineffective.  
Error status:

|    |   |
|----|---|
| OL | Pressure value is too high  |
| LO | Pressure value is too low   |
| SC | Short-circuit or excessive current in the switching output; the PNP-NPN output is switched on. (Flashing) |

## Connection

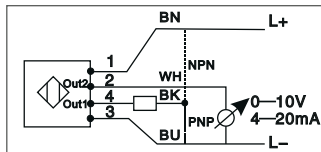

Core color:

- 1 = BN (brown);
- 2 = WH (white);
- 3 = BU (blue);
- 4 = BK (black)

## Electrical connection




The unit must only be connected by an electrician. The national and international regulations for the installation of electrical equipment must be observed.  
Voltage supply according to EN50178, SE LV, PELV. Disconnect power before connecting the product.

## Technical data

Detected objects: Relative medium for gas and liquid

|                                   |  |
|-----------------------------------|--|
| Electric design                   | DC PNP/NPN                                 |
| Operating voltage[V]              | 18...36DC                                  |
| Measuring range[ bar ]            | -1...1/2/5/10/20/50                        |
| Max.overload pressure[ bar ]      | 5/8/20/35/60/140                           |
| Short-circuit protection          | pulse                                      |
| Reverse polarity protection       | Yes  |
| Overload protection               | Yes  |
| Watchdog                          | Yes  |
| Voltage drop[V]                   | <2   |
| Current consumption[mA]           | <60  |
| Analogue output2                  | 4...20mA/0...10V programmable(pressure)    |
| Analogue output load(ohm)         | 4...20mA;Max.(UB-10V)*50/0...10V;Mini:2000 |
| Switching output1                 | NPN/PNP programmable(temperature)          |
| Switching output load(mA)         | 300  |
| switching point SP[°C/°F]         | -39.5...150/-39...302                      |
| recover point RP[°C/°F]           | -40...149.5/-40...301                      |
| step range [°C/°F]                | 0.5/1                                      |
| temperature checking range[°C/°F] | -40...150/-40...302                        |
| switching output[°C/°F]           | 0.5/1                                      |
| display[°C/°F]                    | 0.5/1                                      |
| Ambient temperature[°C/°F]        | -25...80/-13...176                         |
| Medium temperature[°C/°F]         | -25...80/-13...176                         |
| Storage temperature[°C/°F]        | -40...100/-40...212                        |
| Protection rating                 | IP68                                       |
| Insulation resistance[MΩ]         | >100 ( 500VDC)                             |
| ESD                               | 6KV  |
| EFT                               | 2KV  |
| Walkie talkie experiment[mm]      | <10  |
| Shock resistance[g]               | 50   |
| Vibration resistance[g]           | 20   |
| Housing material                  | stainless steel 304                        |
| Probe material                    | stainless steel 316L                       |
| Medium contacting material        | ceramics,stainless 316L;FPM(viton)         |

## Dimensions



## Mounting and maintenance

1. To reduce the shock to the product, please install this product vertically to the flow of medium.
2. To avoid damage of the product, please do not make the loading pressure of the product exceed the range of acceptable pressure by twice.
3. When mounting M12 and adapter, just screw tighten, do not use strength power, and tightening torque is not more than 36Nm(350kgf/cm<sup>2</sup>).

**ema**<sup>®</sup>

M-PB/PC-EN-V1.2

## Electronic Pressure Transmitters



[www.ema-electronic.com](http://www.ema-electronic.com)


## Operating principle

When the pressure acts on the interface of the ceramic diaphragm, the diaphragm is deformed slightly and then connected as a Wheatstone bridge through the thick film resistor printed at the back of the diaphragm. Owing to Piezoresistive Effect from voltage dependant resistor, the electric bridge will produce a high-linear voltage signal with a direct ratio to the pressure, converting the signal to a standard voltage signal via circuit and transmitting the standard voltage to the intelligent system. The digit-segment display shows the value of pressure and then the value will be compared to setting points by the user. Finally, this value is converted to signals for switching output (NPN, PNP) or for analog output. It can also set different warning point and hysteresis by interface circuit of I<sup>2</sup>C to do PNP/NPN outputting.

## Feature

1. Wide power input range broadens the application and reduce the stock effectively.
2. Compact structure without adjustment and easy installation.
3. Low power consumption, low temperature drift, high accuracy, and high stability.
4. Highly resistant to shock, to vibration, and to overload with a solid structure.
5. Unique digital adjustment to ensure high accuracy.
6. Warning points are set discretionally for flexible application.


## Dimension (Unit: mm)

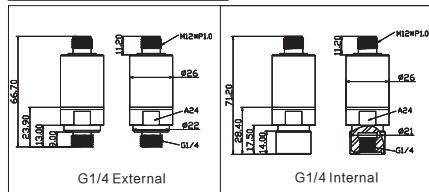

## Functions and features

1. 4~20mA Output
2. 0~10V Output
3. It can also set different warning point and hysteresis by interface circuit of I<sup>2</sup>C to do PNP/NPN outputting.

## Wiring

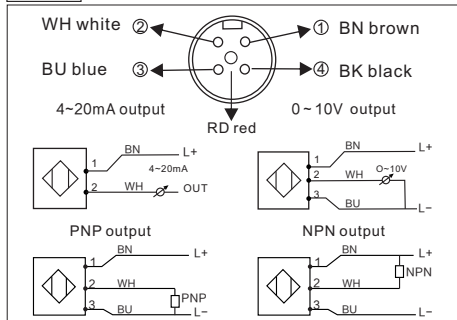

## Certification

1. Meet CE directive
2. Meet UL directive

(Insulation resistance, Impact resistance, electrostatic protection, shock resistance, vibration resistance, drop impact reliability. Average lifetime is not less than 15,000 hours)

## Technical data

| Parameter                   | Specification | PB /PC Series Pressure Transmitter |
|-----------------------------|---------------|------------------------------------|
| Sensing substance           |               | Relative pressure gas and liquid   |
| Voltage output[V]           |               | 8...36DC ( 4...20mA )              |
|                             |               | 18...36DC ( PNP/NPNor0...10V )     |
| Reverse polarity protection |               | Yes                                |
| Voltage drop[V]             |               | < 2                                |

|  |                                 |                 |    |    |    |     |     |     |     |     |     |  |
|--|---------------------------------|-----------------|----|----|----|-----|-----|-----|-----|-----|-----|--|
| Current consumption[mA]                            | < 30                            |                 |    |    |    |     |     |     |     |     |     |  |
| Sensing range[bar]                                 | -1..1                           | 2               | 5  | 10 | 20 | 50  | 100 | 200 | 250 | 400 | 600 |  |
| Burst pressure[bar]                                | 5                               | 8               | 20 | 35 | 60 | 140 | 300 | 400 | 500 | 650 | 880 |  |
| Output   | PB                              | 4 ~ 20mA Output |    |    |    |     |     |     |     |     |     |  |
|  |                                 | 0 ~ 10V Output  |    |    |    |     |     |     |     |     |     |  |
|  | PC                              | PNP/NPN output  |    |    |    |     |     |     |     |     |     |  |
| 4 ~ 20mA Output load [ $\Omega$ ]                  | Maximum500                      |                 |    |    |    |     |     |     |     |     |     |  |
| 0 ~ 10V Output load [ $\Omega$ ]                   | Minimum2000                     |                 |    |    |    |     |     |     |     |     |     |  |
| PNP/NPN Output current[mA]                         | 300                             |                 |    |    |    |     |     |     |     |     |     |  |
| Cable spec.  | M12                             |                 |    |    |    |     |     |     |     |     |     |  |
| Power consumption                                  | 0.72W Max                       |                 |    |    |    |     |     |     |     |     |     |  |
| Operating temperature[ $^{\circ}$ C/ $^{\circ}$ F] | -25...+80/-13...+176            |                 |    |    |    |     |     |     |     |     |     |  |
| Medium temperature[ $^{\circ}$ C/ $^{\circ}$ F]    | -25...+80/-13...+176            |                 |    |    |    |     |     |     |     |     |     |  |
| Storage temperature[ $^{\circ}$ C/ $^{\circ}$ F]   | -40...+100/-40...+212           |                 |    |    |    |     |     |     |     |     |     |  |
| Housing material                                   | Stainless steel 304             |                 |    |    |    |     |     |     |     |     |     |  |
| Probe material                                     | High-class stainless steel 316L |                 |    |    |    |     |     |     |     |     |     |  |
| Insulation resistor[M]                             | > 100 (500 V DC)                |                 |    |    |    |     |     |     |     |     |     |  |
| Resistance to shock[g]                             | 50                              |                 |    |    |    |     |     |     |     |     |     |  |
| Resistance to vibration[g]                         | 20                              |                 |    |    |    |     |     |     |     |     |     |  |
| Protection classification                          | IP68                            |                 |    |    |    |     |     |     |     |     |     |  |

Notice:

1. To reduce shock to this product, this product should be installed vertically to the flow of the substance.
2. To avoid damage, max. overload pressure can not exceed the double of standard sensing range.
3. Please ask technical staff to install this product and follow the domestic or international regulation of electric devices. Power should be turn off before installation.

## 智能电子式压力传感器说明书

模拟量输出

